



Manufacturer of shut-off and control valves

TECHNICAL DATA SHEET

**Ball valve ELEPHANT BV3232P(2pc)-FP-T-H DN8-50 140
bar stainless steel, full bore, threaded, with handle**



+34 900 433 073, sales@valveelephant.com
Carrer d'Aragó, 264, 3-1, 08007 Barcelona, Spain

1. GENERAL PRODUCT INFORMATION

1.1. Наименование изделия: Ball valve ELEPHANT BV3232P(2pc)-FP-T-H DN8-50 140 bar stainless steel, full bore, threaded, with handle.

1.2. Purpose: Ball valves are used as shut-off valves in heating, water supply systems, in steam, fuel and pneumatic systems with compressed air and neutral gases. Installation of valves of this series is possible in systems transporting liquid and gaseous media (water, oil, oils, steam, air, alcohols, glycol, etc.), not aggressive to the materials of the valve.



1.3 Principle of operation: The working flow is closed by means of a locking element, which is a ball with a through cylindrical hole. The ball is rotated around the axis by means of a handle mounted on the body. It is sufficient to turn it by 90 degrees to completely shut off the flow.



**изображение может отличаться от оригинала*



1.4. Deciphering the designation:

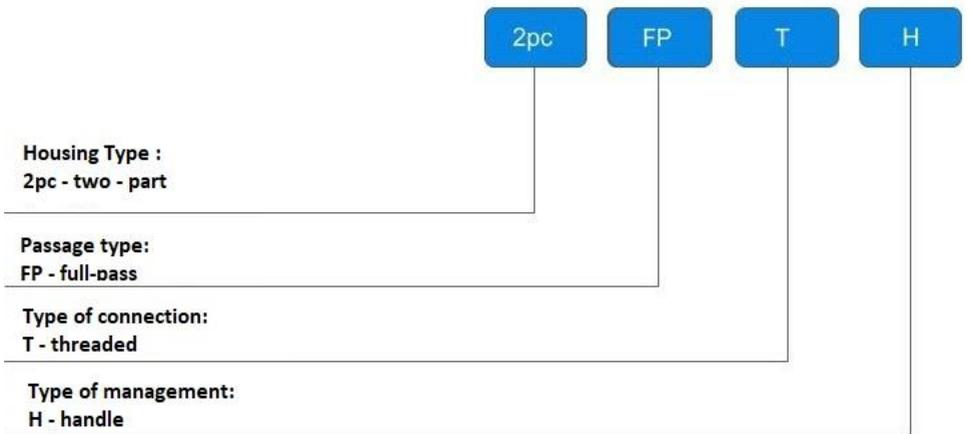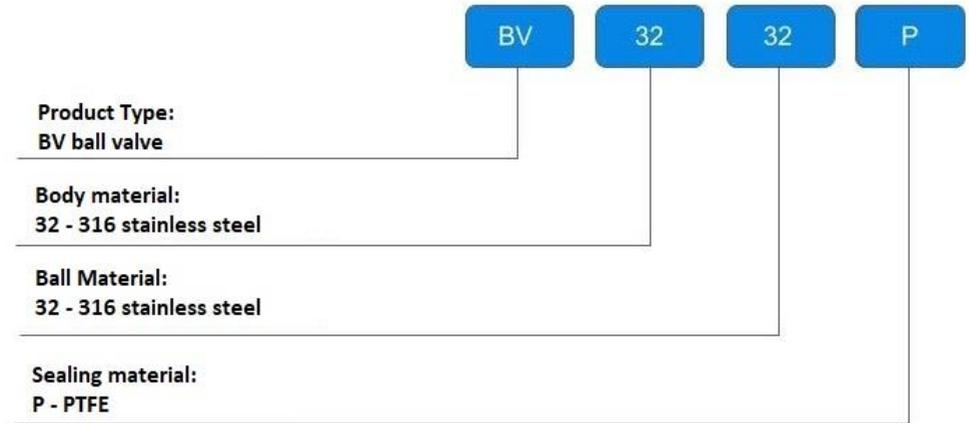

2. BASIC TECHNICAL DATA AND CHARACTERISTICS


Table 1

Nominal diameter DN, mm	8-50
Nominal pressure PN, bar	140
Working medium temperature t, °C	-25 to +180
Working medium	Water, steam, petroleum products and other liquid or gaseous media neutral to valve materials
Connection to pipeline	threaded BSPP
Type of through section	full bore
Ball valve tightness class	«A»
Control type	manual
Areas of application	heating and water supply systems, industrial piping
Service life, years	10

Table 2

	DN8	DN10	DN15	DN20	DN25	DN32	DN40	DN50
Flow coefficient Kv, m ³ /h	10	10	18	38	75	83	130	205



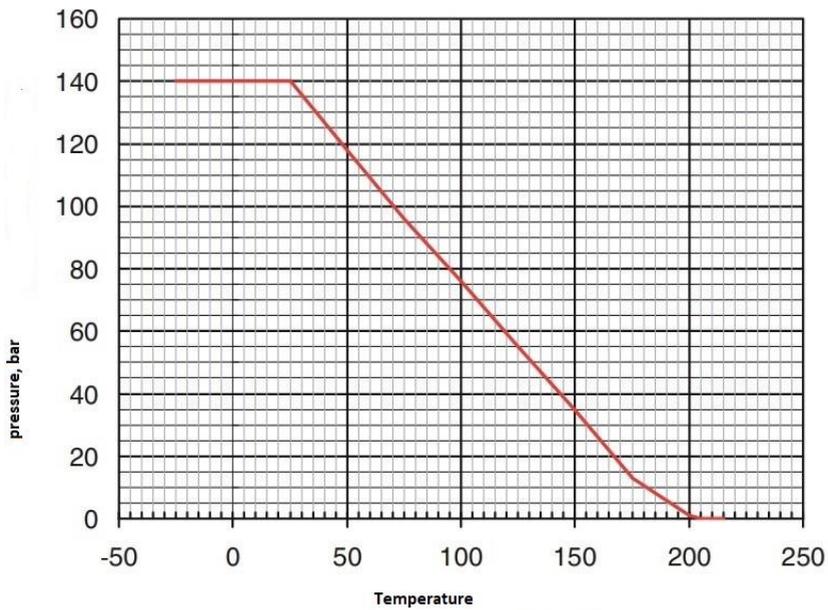

3. BASIC MATERIALS

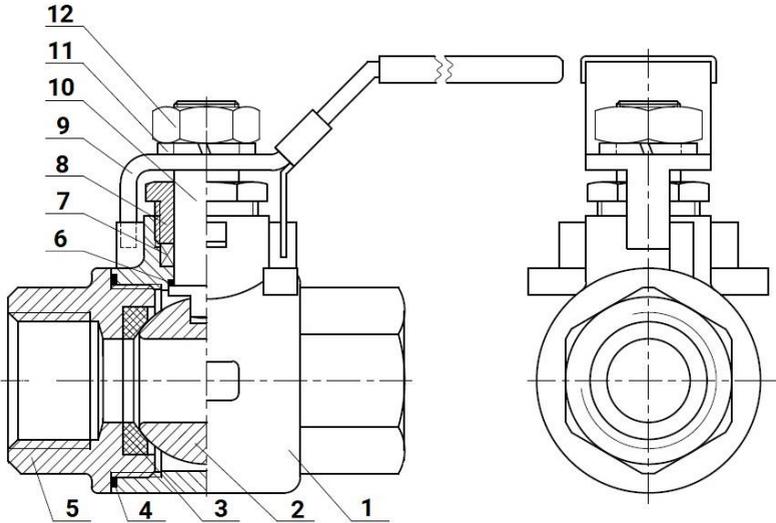


Table 3

№	Part name	Material
1	Body	SS316 stainless steel
2	Ball	SS316 stainless steel
3	Seal	PTFE + 25% graphite
4	Gasket	PTFE
5	Connecting cover	SS316 stainless steel
6	Stop gasket	PTFE
7	Packing	PTFE
8	Gland nut	SS304 stainless steel
9	Handle	SS201 stainless steel + PVC
10	Stem	SS316 stainless steel
11	Wire jaw	SS304 stainless steel
12	Nut	SS304 stainless steel



4. WEIGHT AND DIMENSIONAL PARAMETERS

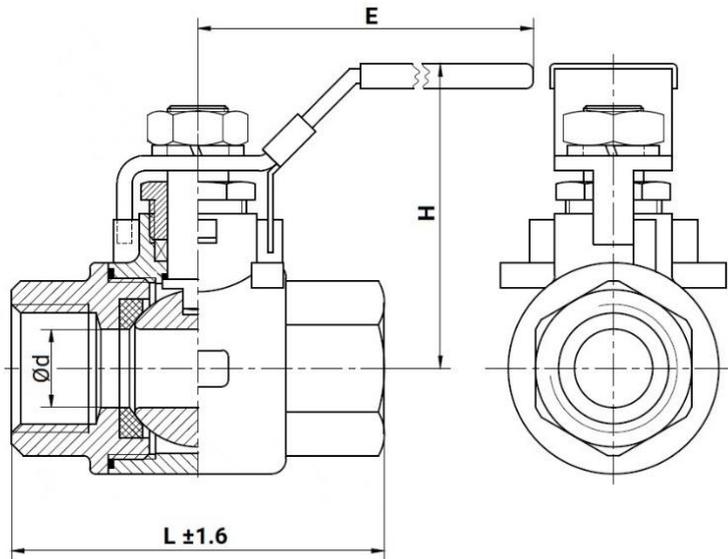


Таблица 4

	d, mm	H, mm	E, mm	L, mm	Weight, kg
DN8	8	45	100	61	0,250
DN10	10	45	100	61	0,240
DN15	15	55	110	64	0,320
DN20	20	65	120	72	0,600
DN25	25	70	130	84	0,880
DN32	32	80	150	94	1,220
DN40	38	90	160	110	1,800
DN50	49	95	180	123	2,700



5. OPERATING INSTRUCTIONS

5.1. It is forbidden:

- use ball valves as regulating valves;
- allow the working medium to freeze inside the ball valve;
- operate the products under conditions and parameters that do not correspond to the nameplate values;
- to perform installation, dismantling, preventive maintenance work in the presence of the working medium and pressure in the pipeline;
- use ball valves instead of plugs when testing pipeline systems;
- use ball valves as supports for pipelines;
- use levers (gas keys, extensions) that increase the leverage of the handle to operate the valve;
- install products on systems with a working medium containing abrasive components.

5.2. To avoid water hammer in the pipeline to open and close the valve smoothly, without jerking.

5.3 It is not allowed to operate the valve with loosened handle fastening nut, as it may lead to stem neck breakage.

5.3 For preventive purposes, as well as to prevent the formation of karst deposits on the surface of the ball, it is required several times a year to perform 2-3 cycles “open-close”.

5.4 If the ball valve is used with a working medium with a high content of mechanical impurities, the installation of additional filtering equipment at the inlet is mandatory.

5.5. During the installation and operation of cranes, safety requirements must be complied with in accordance with the procedure established at the enterprise.

5.6. Maintenance of the valves in operation is reduced to periodic inspections. In this case, the stroke of the valve stem is checked until the valve is fully opened-closed, no leaks are detected.



6. INSTALLATION INSTRUCTIONS

6.1. The ball valve may be installed on the pipeline section in any mounting position that provides ease of operation and access to the actuator.

6.2 Installation and dismantling of the product, as well as any repair or adjustment operations should be performed in the absence of pressure in the system.

6.3 Before installing the valve, the pipeline should be cleaned of dirt, sand, scale and any foreign objects.

6.4 The ball valve should not experience loads from the pipeline (bending, compression, stretching, torsion, warping, vibration, misalignment of spigots, uneven tightening of fasteners). If necessary, supports or compensators should be provided to reduce the load on the valve from the pipeline.

6.5 After installation it is necessary to check the performance of the valve by turning the handle, in this case moving parts should move smoothly, without jerks and seizures. Tightness tests of connections are carried out in accordance with the procedure established at the enterprise.

7. TRANSPORTATION AND STORAGE CONDITIONS

7.1. Ball valves are transported in accordance with the procedure established at the enterprise.

7.2. Storage should be carried out in the factory packaging in accordance with the procedure established at the enterprise.

7.3. At shipment to the customer the valves are not subjected to preservation, as the materials used in their manufacture are weatherproof and have a protective coating.

7.4 In the process of storage, transportation ball valves do not harm the environment and human health.

8. UTILIZATION

8.1. The product is disposed of in accordance with the procedure established at the enterprise (remelting, burial, resale).



9. WARRANTY OBLIGATIONS

9.1. Warranty period - 12 months from the date of commissioning, but not more than 18 months from the date of sale.

9.2. The warranty applies to equipment installed and used in accordance with the installation instructions and product specifications described in this data sheet.

9.3. The manufacturer guarantees compliance of the product with safety requirements, provided that the consumer complies with the rules of transport, storage, installation and operation.

9.4. The warranty covers all defects caused by the fault of the manufacturer.

9.5. The warranty does not apply:

- parts and materials of the product subject to wear and tear;
- for cases of damage caused by:
 - modifications to the original design of the product;
 - violation of general installation recommendations;
 - faults caused by improper maintenance and storage; improper operation and use of the equipment.

10. WARRANTY TERMS

10.1. Claims to the quality of the goods may be made during the warranty period.

10.2. Defective products are repaired or exchanged for new ones free of charge during the warranty period. ELEPHANT decides whether to replace or repair the product. The replaced product or its parts resulting from the repair shall become the property of 'ELEPHANT'.

10.3. Costs related to dismantling, installation and transport of the defective product during the warranty period shall not be reimbursed to the Buyer.

10.4. If the claim is unfounded, the Buyer shall pay the costs of diagnostics and expertise of the product.

10.5. Products are accepted for warranty repair (as well as for return) fully assembled.



WARRANTY CARD № _____

№	Product Name	Packs

Name and address of the trading organisation _____

Date of sale _____ Seller's signature _____

Stamp or seal of the trading organisation _____ Acceptance stamp _____

I agree with the terms and conditions of the warranty:

Buyer _____ (signature)

Warranty period - 12 months from the date of commissioning, but not more than 18 months from the date of sale.

For warranty repairs, complaints and product quality claims, please contact ELEPHANT at: Carrer d'Aragó,264,3-1,08007 Barcelona, Spain_E-mail address: sales@valveelephant.com.

When making a complaint about the quality of goods, the buyer shall present the following documents:

1. A free-form application, which shall specify:
 - name of the organisation or full name of the buyer, actual address, contact telephone numbers;
 - name and address of the organisation that carried out the installation;
 - basic parameters of the system in which the product was used;
 - a brief description of the defect.
2. Document confirming the purchase of the product (delivery note, receipt)..
3. Act of hydraulic test of the system in which the product was installed.
4. This completed warranty card.

A note on the return or exchange of goods _____

Date: « ___ » _____ 202__ r. Caption _____

